



Operating manual - Safety groups ELTERM

ELTERM M.M.Kaszuba Sp.J., ul. Przemysłowa 5, 86-200 Chełmno, www.elterm.pl


Application:

Safety groups are devices designated to attach membrane vessel, equipped in components against pressure increase in installation, i.e. manometer, safety valve and air vent (central heating safety groups only). Hot domestic water safety group does not need air vent, as venting is performed while opening tap.


Advantages:

Besides aesthetic execution (powder paint), Elterm safety groups are firmly MAG welded, made of thick-walled steel and available in 6 or 8 bar versions. We use components from reputable manufacturers only. All products undergo 100% pressure check as well.

Central heating safety group

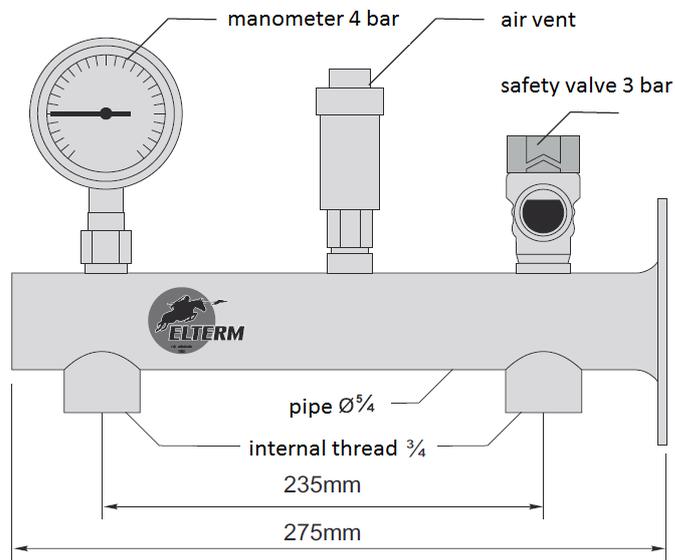

Hot utility water safety group

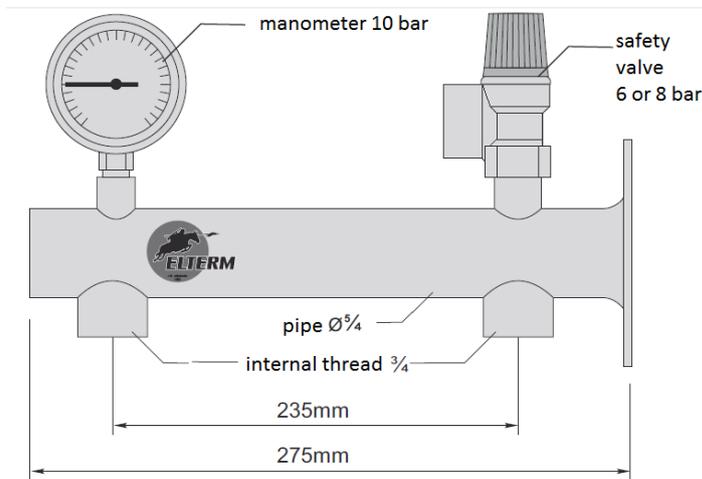

WARRANTY

- ✓ The manufacturer gives warranty for faultless operation of device for a period of 2 years (24 months) of the date of sale.
- ✓ Warranty repairs are made by the manufacturer or authorised representative of the same.
- ✓ Warranty expires if any alterations are made to the product without the manufacturer's consent, or if the product covered by the warranty is used against its intended purpose, in which cases the manufacturer shall not be held liable for any negative effects of such product use.
- ✓ The user is responsible for strict adherence to the operating and installation manual for the device, paying particular attention to the maximum admissible technical parameters provided in the relevant catalogue sheet.
- ✓ Failure to adhere to the above renders the warranty void.
- ✓ Incomplete warranty is invalid.
- ✓ Specific cases not covered by this warranty are regulated by the Civil Code.

Producer seal	Date of sale	Seller seal and signature

Declaration of conformity EN1/2016

Elterm M.M. Kaszuba Sp.J., ul. Przemysłowa 5, 86-200 Chełmno

We herewith declare, under our sole responsibility, that the following products:

- **safety units for CH and UHW:** GBCO 3 bar; GBCWU 6 bar/8bar; GBCWU INOX 6bar/8bar
- **connecting manifolds:** 2-way; 3-way and manufactured against special order
- **chemical dosing pots:** DCE 3,5l; DCE 5l; DCE 10l; DCE 15l; DCE 25l
- **magnetic filter-desilters:** Dryl 37 25/76; Dryl 60 32/89; Dryl 95 40/114; Dryl 144 50/133
- **external cooling coils:** Strażnik 32 40/133; Strażnik 45 50/133

Manufactured by ELTERM conform to the pressure equipment directive 2014/68/UE; EN 13445 "Unfired pressure vessels" as amended - UNM and to the ordinance by the Minister of Economy of 11.02.2015 on the absolute requirements concerning pressure equipment and pressure equipment units (Journal of Laws Dz.U.2015 poz. 244).

Relevant conformity assessment procedure: Internal production control – module A (in accordance with 2014/68/UE – equipment up to category I). Usable for water with $T < 110^{\circ}\text{C}$, for the remaining maximum admissible operating parameters and dimensions see the relevant manual or catalogue sheets available at www.elterm.pl

Chełmno, July 19th, 2016

Maciej Kaszuba
